

Effast from Polypipe is a well-established brand name that is recognised for its range of thermoplastic pipework suitable for use within industrial, food & beverage processing and building services.



PVCu



ABS



Polypropylene




PE100

The Effast range consists of 4 different systems

- PVCu
- ABS
- Polypropylene
- PE100

Thermoplastics expand and contract to a greater extent than metals and this movement needs to be calculated and controlled.

The chart below shows the comparison between the thermal expansion of plastics and metals.

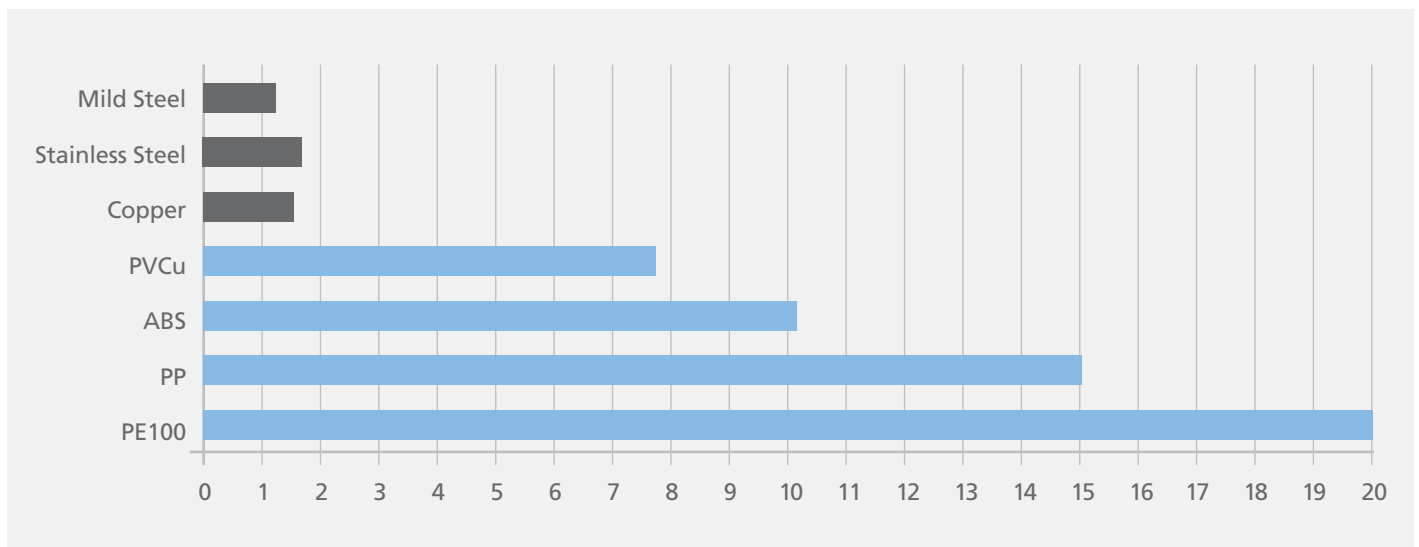

There are two factors to consider when calculating expansion or contraction in pipes:

- Environmental temperature (external temperature) at which the pipe will stabilise prior to installation
- Fluid temperature (internal temperature) which is the operational temperature of the pipeline system

Where:

ΔT = Difference in temperature between the installation and the operating temperatures in °C $\Delta T = (T_{\text{operate}} - T_{\text{install}})$

L = Length of pipe when installed

δ = Coefficient of expansion

The change in length due to thermal expansion or contraction in a pipeline system is determined by the following formula:-

$$\Delta L = \Delta T \times L \times \delta$$

COEFFICIENT OF LINEAR EXPANSION FOR THERMOPLASTICS (δ)


| Thermoplastic material | Coefficient δ (10-5m/m°C) | Length/temperature equivalent (mm/m°C) |
|------------------------|----------------------------------|--|
| PVCu | 7.8 | 0.078 |
| ABS | 10.1 | 0.101 |
| PP | 15.0 | 0.150 |
| PE100 | 20.0 | 0.200 |

Flexible arms in pipeline installations


Flexible arms or expansion bellows are used in order to avoid the associated stresses generated from a pipe's change in length due to expansion or contraction. Expansion bellows are not a prime concern of this document and the installer is advised to seek specialist guidance from the manufacturers of such products.

The flexibility of plastics permits expansion or contraction to be compensated for by means of either directional change within a pipe system (single flexible arm) or by the installation of expansion loops consisting of two flexible arms (double flexible arm), as shown in the following illustrations: -

Single arm

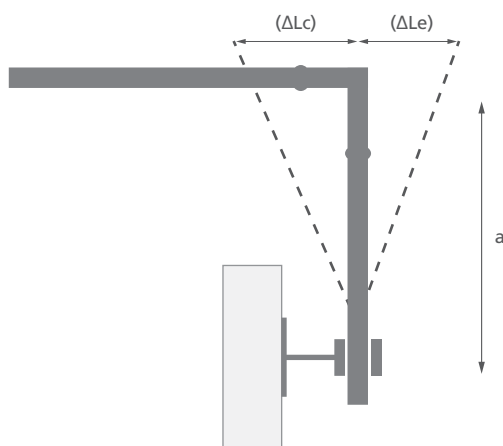

Double arm (expansion loop)

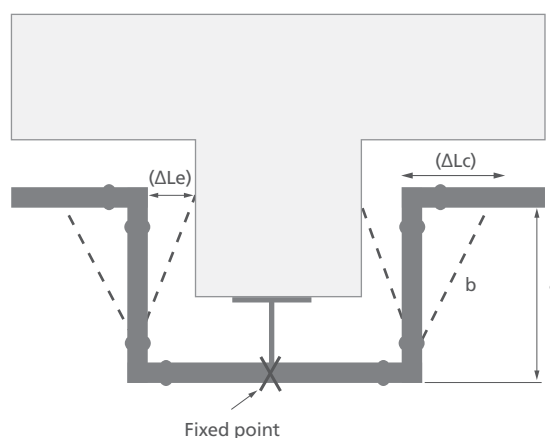

How to find the flexible arm (a) length

To calculate the length of a flexible arm (a) the following formulae can be used:-

Single arm: $a = (\sqrt{D \times \Delta L}) \times C_m$

Double arm: $a = (\sqrt{D \times \frac{\Delta L}{2}}) \times C_m$

Where:

a = Flexible arm length (mm)

D = Pipe outside diameter (mm)

ΔL = Expansion or Contraction (mm) for single arm, for double arm use ΔL/2

C_m = Constant for material, see table below

THERMOPLASTIC MATERIAL CONSTANT (C_m)

| Thermoplastic material | Constant |
|------------------------|----------|
| PVCu | 33.5 |
| ABS | 32.7 |
| PP | 30.0 |
| PE100 | 26.0 |

Worked Example

Find the expansion length and leg size on a 20mm diameter PVCu pipe system installed at 10°C, where the maximum and minimum operating temperatures are 30°C and 8°C respectively and the overall length of the installation is 30m.

SOLUTION

| Step | | Operating temperature (°C) | |
|------|---|---|---------------------------------|
| | | 30 | 8 |
| 1 | Calculate temperature difference $\Delta T = (T_{\text{operate}} - T_{\text{install}})$ | = 30-10 = +20°C | = 30-10 = -2°C |
| 2 | Calculate change in length due to expansion and contraction $\Delta L = \Delta T \times L \times \delta$ ($\delta = 0.078$ for PVCu) | = 20 x 30 x 0.078 = 46.8mm | = -2 x 30 x 0.078 = -4.68mm* |
| 3 | Select length of flexible arm or compensator | Take the greater value (change in length) regardless of whether it is due to expansion or contraction that can accommodate the maximum movement. In this case $\Delta L = 46.8\text{mm}$ | |

*Please note a (-) minus value represents the difference in temperature (it is not a subzero) and hence it causes a contraction of the length of the pipe.

The next step is to take this ΔL and work out the size of the expansion leg.

SOLUTION

| Single arm | Double arm (expansion loop) |
|---|---|
| $a = (\sqrt{D \times \Delta L}) \times C_m$ | $a = (\sqrt{D \times \frac{\Delta L}{2}}) \times C_m$ |
| $a = (\sqrt{20 \times 46.8}) \times 33.5$ | $a = (\sqrt{20 \times \frac{46.8}{2}}) \times 33.5$ |
| a = 1024.9mm | a = 724.7mm |

Pre-stressing flexible arms

Sometimes changes of length (ΔL) can only be channelled in one direction, possibly due to a flexible section having to operate in a confined space. When this occurs the flexible arm can be prestressed achieving the following:

- The flexible arm can be reduced in length
- The flexible arm will straighten under working conditions thus relieving a large amount of stress
- The installation will look better when in service



Contact Us

to find out about our Technical Workshop

Next month's
bulletin will be
on Bracketry